


**VILLAGE OF VERNON HILLS
EXHIBIT NO. 46**

PARKING LOT ISLAND DRAIN PIPE

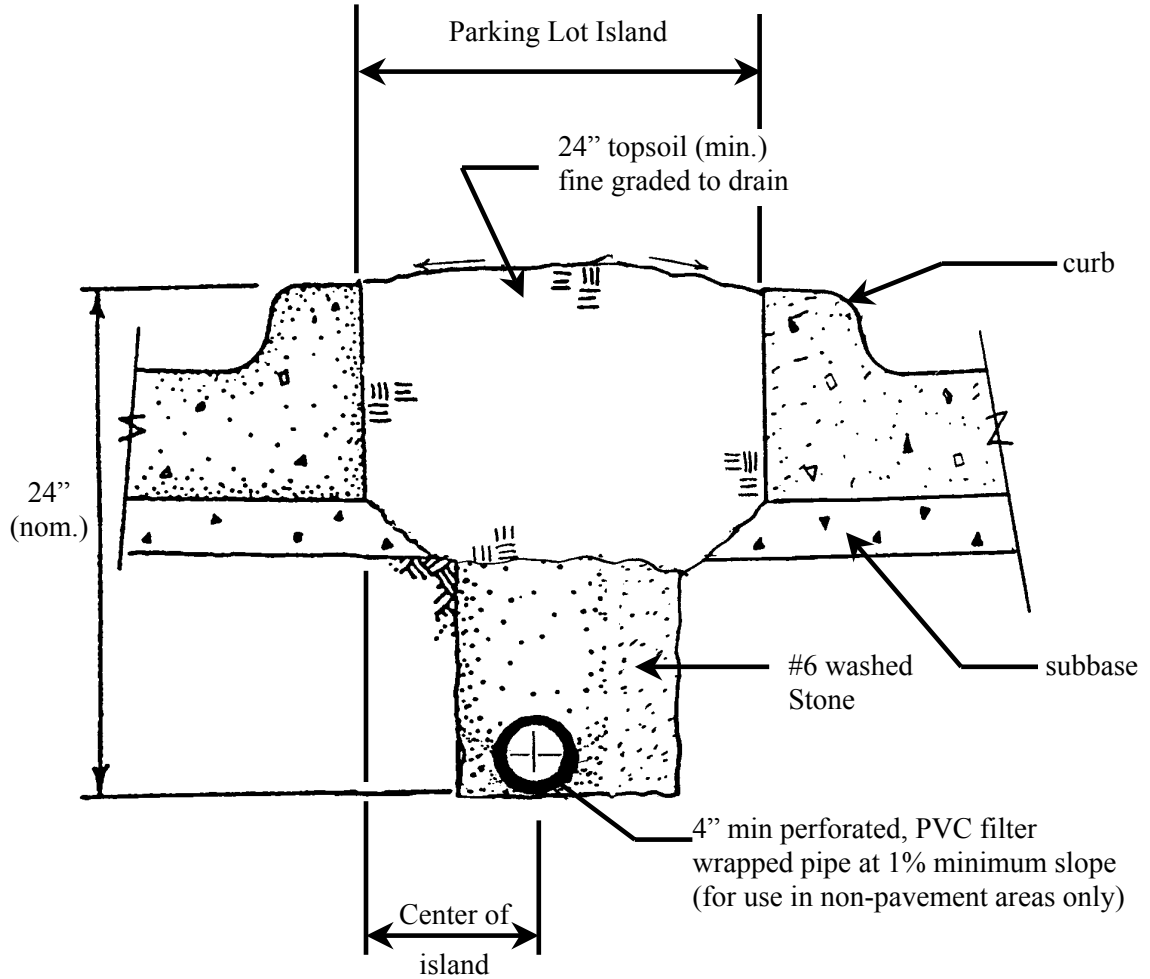

Notes:

1. Drainpipe connections to storm structures are to be machine cored and booted. See Exhibit No. 43.
2. Drainpipe outside of islands, parkways, and landscaped areas is to be SDR 21 PVC, non-perforated. Trench and backfill is required within pavement areas.
3. The Contractor is responsible to coordinate the location of signs, monuments, and lightpole foundations to avoid the drainpipe.